

**OWS Tiles - 600x300mm Micro Cemento Tiles - Wet Sliptest SN270223-5**

27 Feb 2023

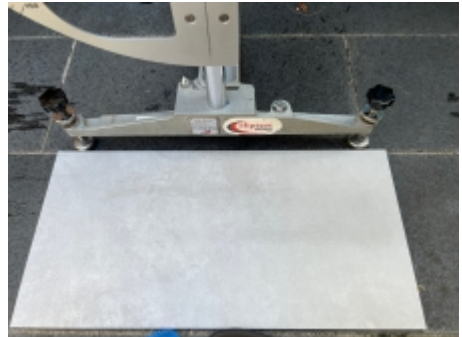
**Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A**

Date Tested:	27 Feb 2023
Test Report Number:	SN270223-5
Client Name & Billing Address:	OWS International Building Materials Pty Ltd - Unit 1/17 Pavesi Street, Smithfield NSW 2164
Project Name or Test Location:	Sliptest Australai Pty Ltd Headquarters - 4 Bindon Place, Zetland NSW
Surface Tested : (Samples and Test Information Supplied by Client)	300x600cm Micro Cemento - Light Grey Stone Look Tile / Fine Texture
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Any Variations to Standards	N/A
Testing Officer / Approved Signatory:	Shenea Neill
Pendulum in use - Calibration Date :	#1133 - Munro-Stanley Portable Skid Tester (C : 14.10.21)

Signature of Approved Signatory :



**Test Results :**

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	SCV :	Surface Picture
Tile 1	54	53	51	51	51	51	N/A	
Tile 2	56	55	54	54	54	54	N/A	
Tile 3	55	54	54	53	53	53	N/A	
Tile 4	53	53	53	53	53	53	N/A	
Tile 5	54	53	53	52	52	52	N/A	

Reported SRV For Test Area : 53

CLASSIFICATION using Slider 96 (4S Slider) P4 = 45 - 54

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A - Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results to not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

